

SCR - G-1674073

RME-G-2140694

General Notes

1.All new pipe to be black sch 40 ASTM 135

2.All new fittings to be black cast iron

3.New heads to be Quick Response Chrome Pend.

4.All exisitng outlets not used to be plugged

5.All areas labled N.I.C to be not in contract.

6.All areas to be Light Hazard CLINIC/OFFICE (u.n.o.)

7.Any required painting and/or labeling to be provided by owner.

8.All materials to be U.L. Listed or F.M. Approved or Approved by the Local Authority Having Jurisdiction.

9.All Sprinklers to be spaced and located as required by NFPA 13 2010 and manufacturer's specifications.

10.All hangers per NFPA 13 2010 and manufacturer's specifications.

11.It is the building owners responsibility to provide adequate heat for all areas in the building protected by wet sprinkler systems.

NOTE*****


ALL SPRINKLER HEADS TO BE ON NEW 1" SCH 40 BLACK STEEL PIPE WITH CAST IRON SCREWED FITTINGS ALL HEADS TO BE QUICK RESPONSE SPRINKLER HEADS (U.N.O.)


SCOPE OF WORK

LEASE SPACE PROTECTED BY EXISTING FIRE SPRINKLER SYSTEM.

ALL HEADS ARE NEW DROPS, FIRST TIME OFFICE BUILD OUT.

PROVIDE ADEQAUTE FIRE SPRINKLER COVERAGE FOR NEW REMODELED LEASE SPACE.

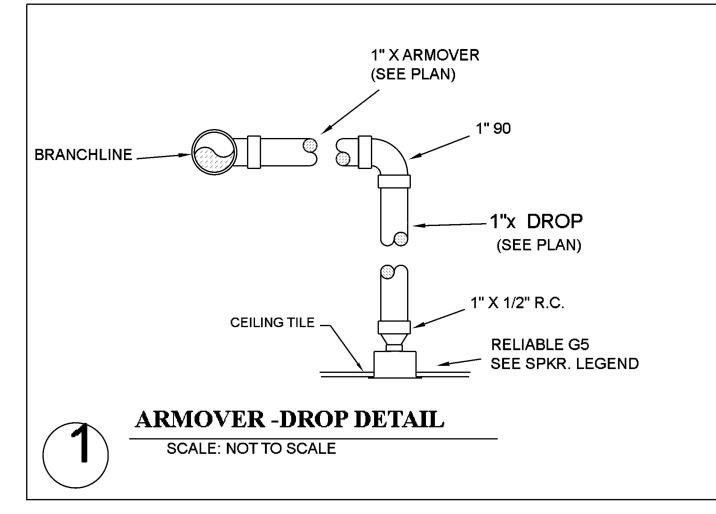

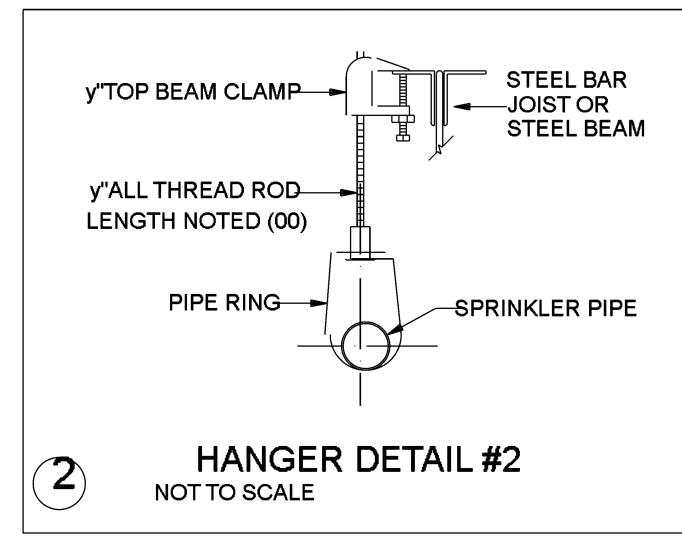

	BY		● NS	Jyco	TY323 TY-FRB	ထ	5.6 Pendent % Quick	%	ĭick
	₹10000 EMMETT F. LOWRY EXPRESSWAY TEXAS CITY, TX. 77591		;			Total = 30			
		XXX							
1/	SHEET NAME	(XXX		† *	*TY-FRR TYCO HEADS OR FOLL	O HEA	DS OR	CH	Ξ
18/202	FIRE SPRINKLER LAYOUT	xxxxxx	xx/xx/x	•				j I	5
3	<u> </u>		ιx						

FP 1 of 2